

Test 2 v10b night at balcony

Humidity

H_1B_011.CSV


Measurement for time 4:40

HIH7120	SHT85	AHT10	AHT20	AHT21	AHT25
61.82	63.45	61.12	60.91	59.43	69.38
		60.84	61.78	57.03	66.72
		61.47	60.58	55.26	66.6
		62.92	60.51	58.59	71.92
		61.14	60.24	57.66	68.05
		62.82	61.88	60.6	66.78
		59.72	61.15	56.95	66.27
		61.99	61.61	58.73	68.34
61.82	63.45	61.50	61.08	58.03	68.01


Average measurement for time 4:40

HIH7120	SHT85	AHT10	AHT20	AHT21	AHT25
61.82	63.45	61.50	61.08	58.03	68.01

Humidity trend overview

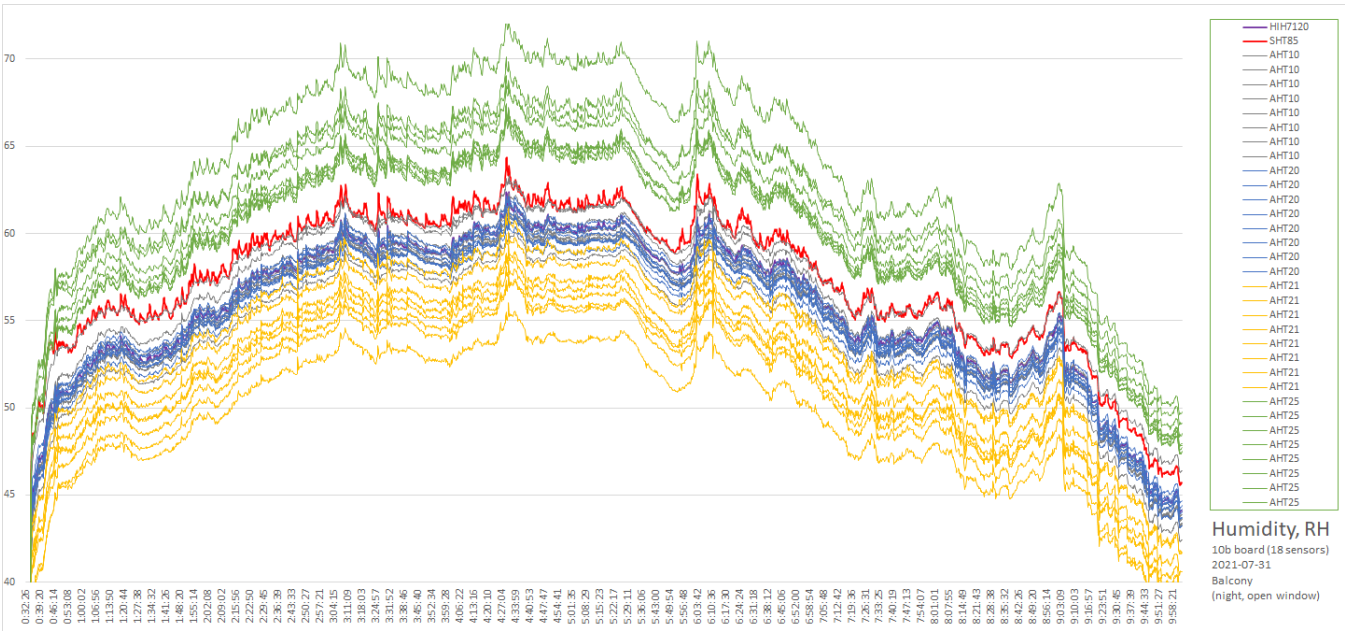

Humidity trend fragment

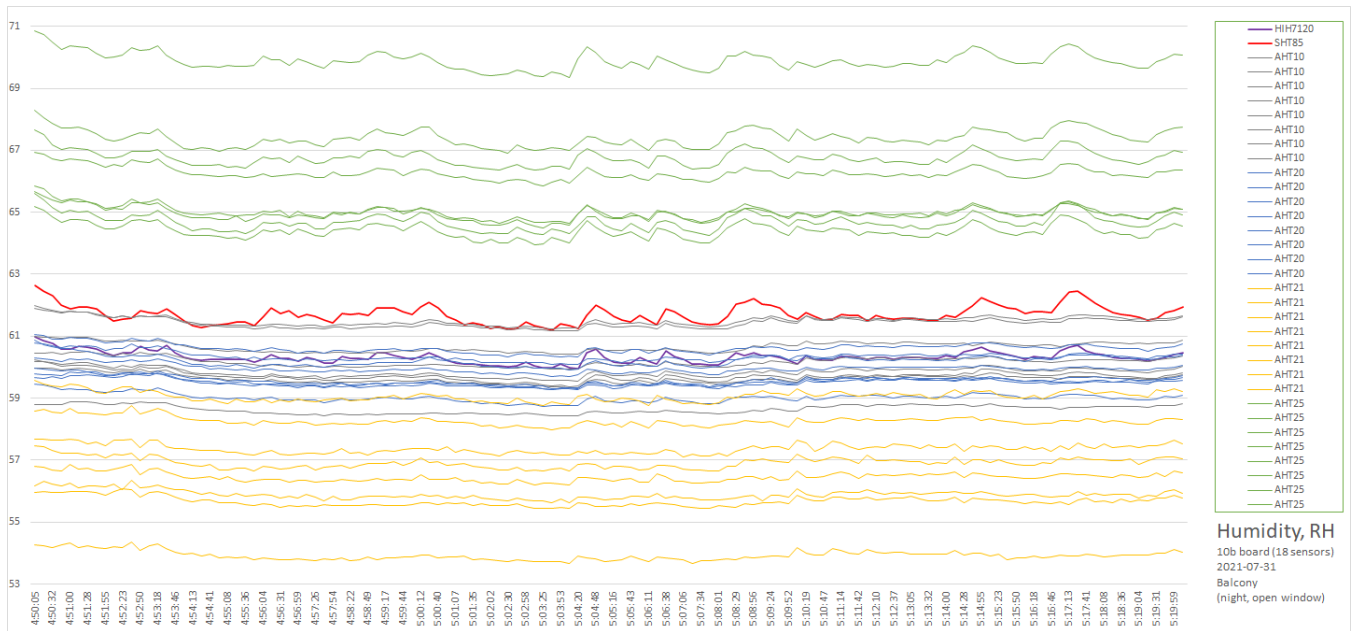

Temperature

T_1B_011.CSV


Measurement for time 4:40

HIH7120	SHT85	AHT10	AHT20	AHT21	AHT25
23.91	23.42	23.93	23.03	23.4	23.7
		23.73	23.05	23.79	23.6
		23.45	23.37	23.18	24.11
		23.42	23.58	23.44	23.91
		23.54	23.29	23.14	23.79
		23.5	23.37	22.91	23.65
		23.73	23.22	23.48	23.91
		23.56	23.43	23.25	24.04
23.91	23.42	23.61	23.29	23.32	23.84

Average measurement for time 4:40

HIH7120	SHT85	AHT10	AHT20	AHT21	AHT25
23.91	23.42	23.61	23.29	23.32	23.84

Temperature trend overview

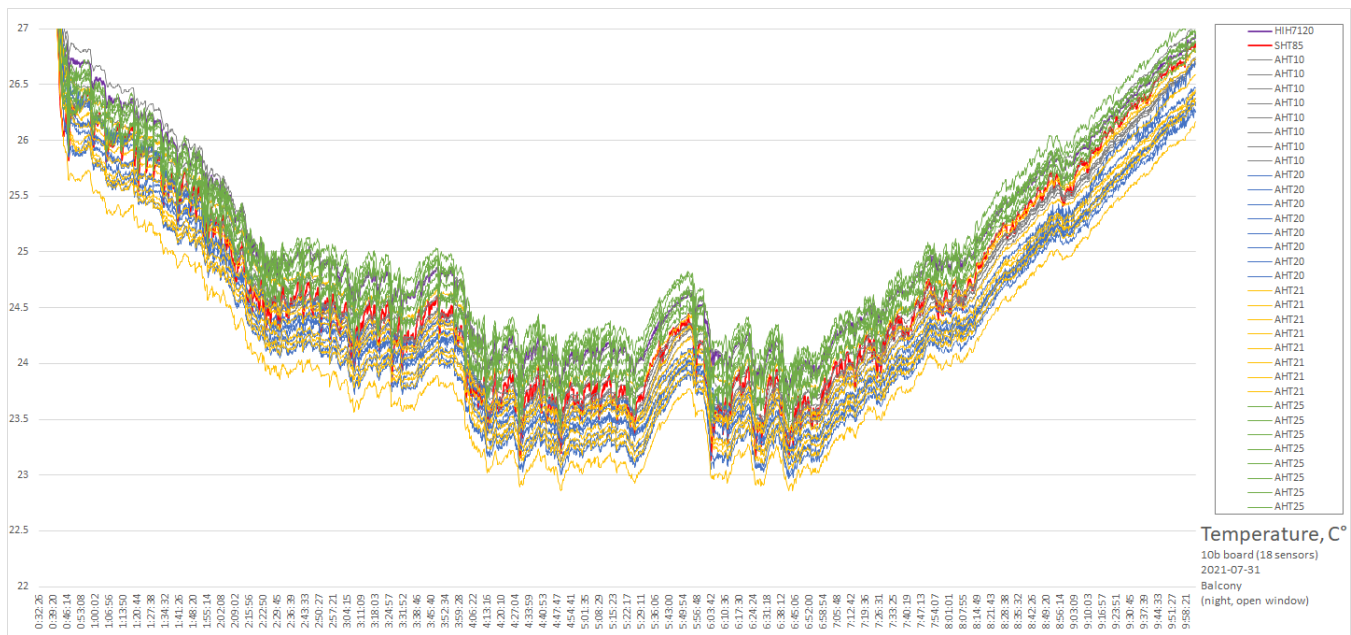

Temperature trend fragment

