

Test 6 v10b Freezer 2

Humidity

H_1B_030.CSV


Measurement for time 1:36

HIH7120	SHT85	AHT10	AHT20	AHT21	AHT25
56.55	56.4	48.32	39.11	52.84	57.32
		46.57	47.75	50.66	51.65
		49.38	51.34	49.35	51.68
		42.06	76.04	52.68	53.98
		44.08	46.94	48.72	54.55
		42.02	46.05	50.48	53.09
		49.34	51.52	50.07	47.14
		50.39	49.37	58.4	53.71
56.55	56.40	46.52	51.02	51.65	52.89


Average measurement for time 1:36

HIH7120	SHT85	AHT10	AHT20	AHT21	AHT25
56.55	56.40	46.52	51.02	51.65	52.89

Humidity trend overview

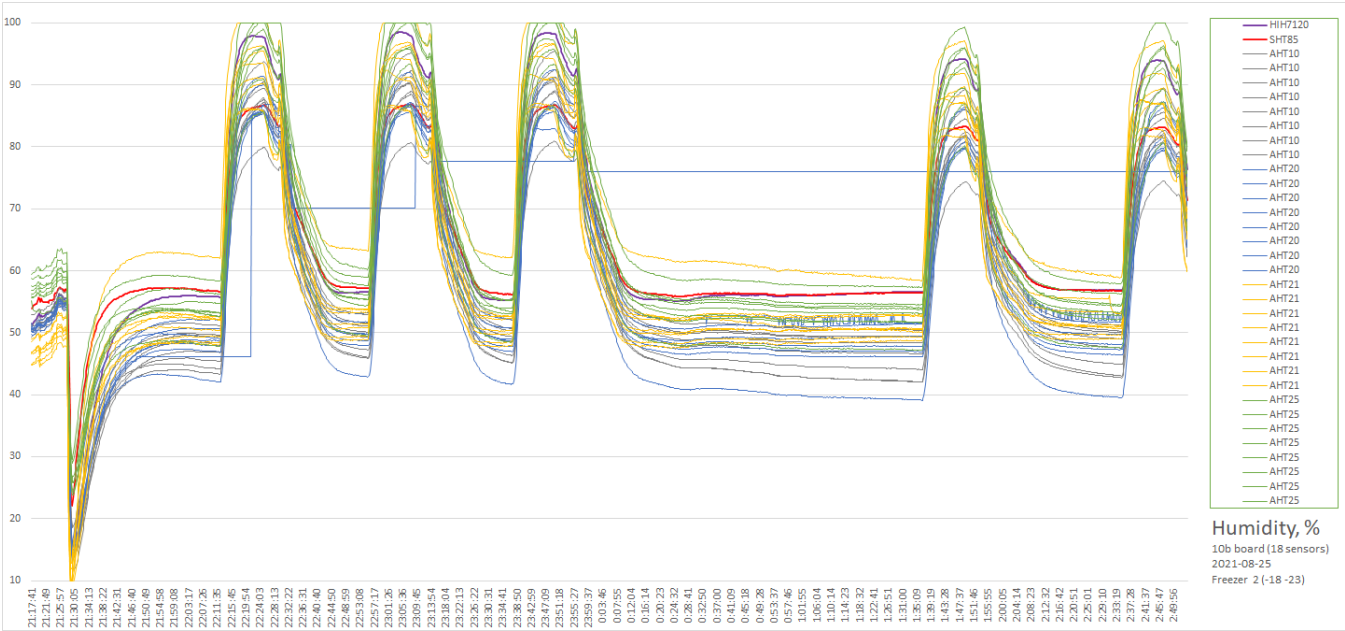

Humidity trend fragment

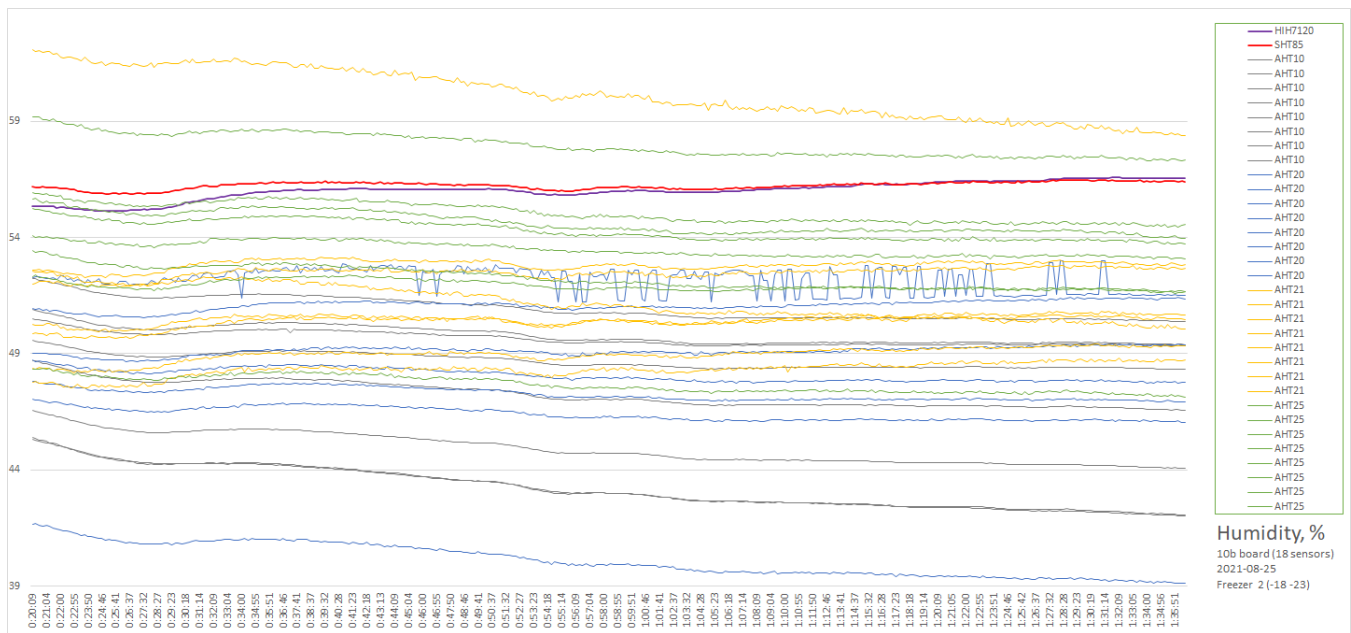

Temperature

T_1B_030.CSV


Measurement for time 1:36

HIH7120	SHT85	AHT10	AHT20	AHT21	AHT25
-22.56	-25.49	-26.56	-26.17	-26.06	-18.16
		-25.8	-28.3	-25.33	-18.54
		-27.74	-28.12	-26.69	-18.98
		-27	-17.6	-28.32	-18.72
		-26.41	-27.85	-27.17	-18.89
		-26.16	-26.81	-26.37	-18.96
		-28.34	-28.27	-26.41	-17.67
		-25.53	-29.96	-26.07	-17.92
-22.56	-25.49	-26.69	-26.64	-26.55	-18.48

Average measurement for time 1:36

HIH7120	SHT85	AHT10	AHT20	AHT21	AHT25
-22.56	-25.49	-26.69	-26.64	-26.55	-18.48

Temperature trend overview

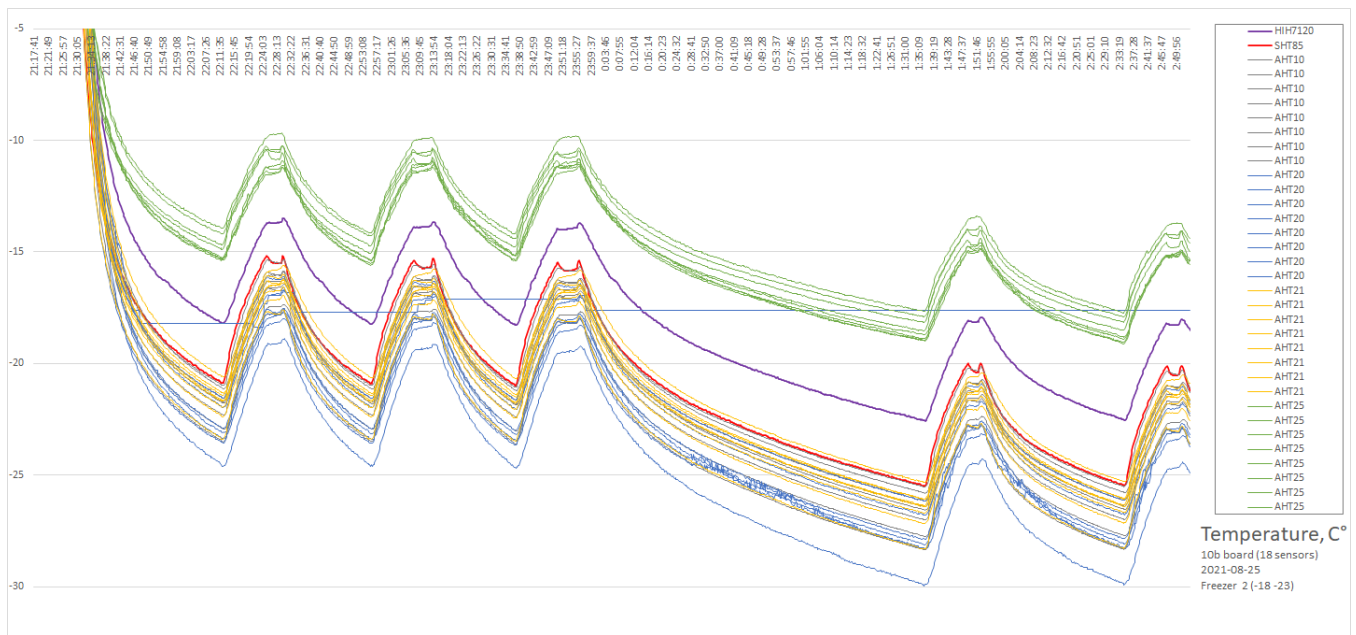

Temperature trend fragment

